


**PLAN VIEW**  
(2" METER ASSEMBLY WITH 4" DOMESTIC WATER LINE)  
NOT TO SCALE

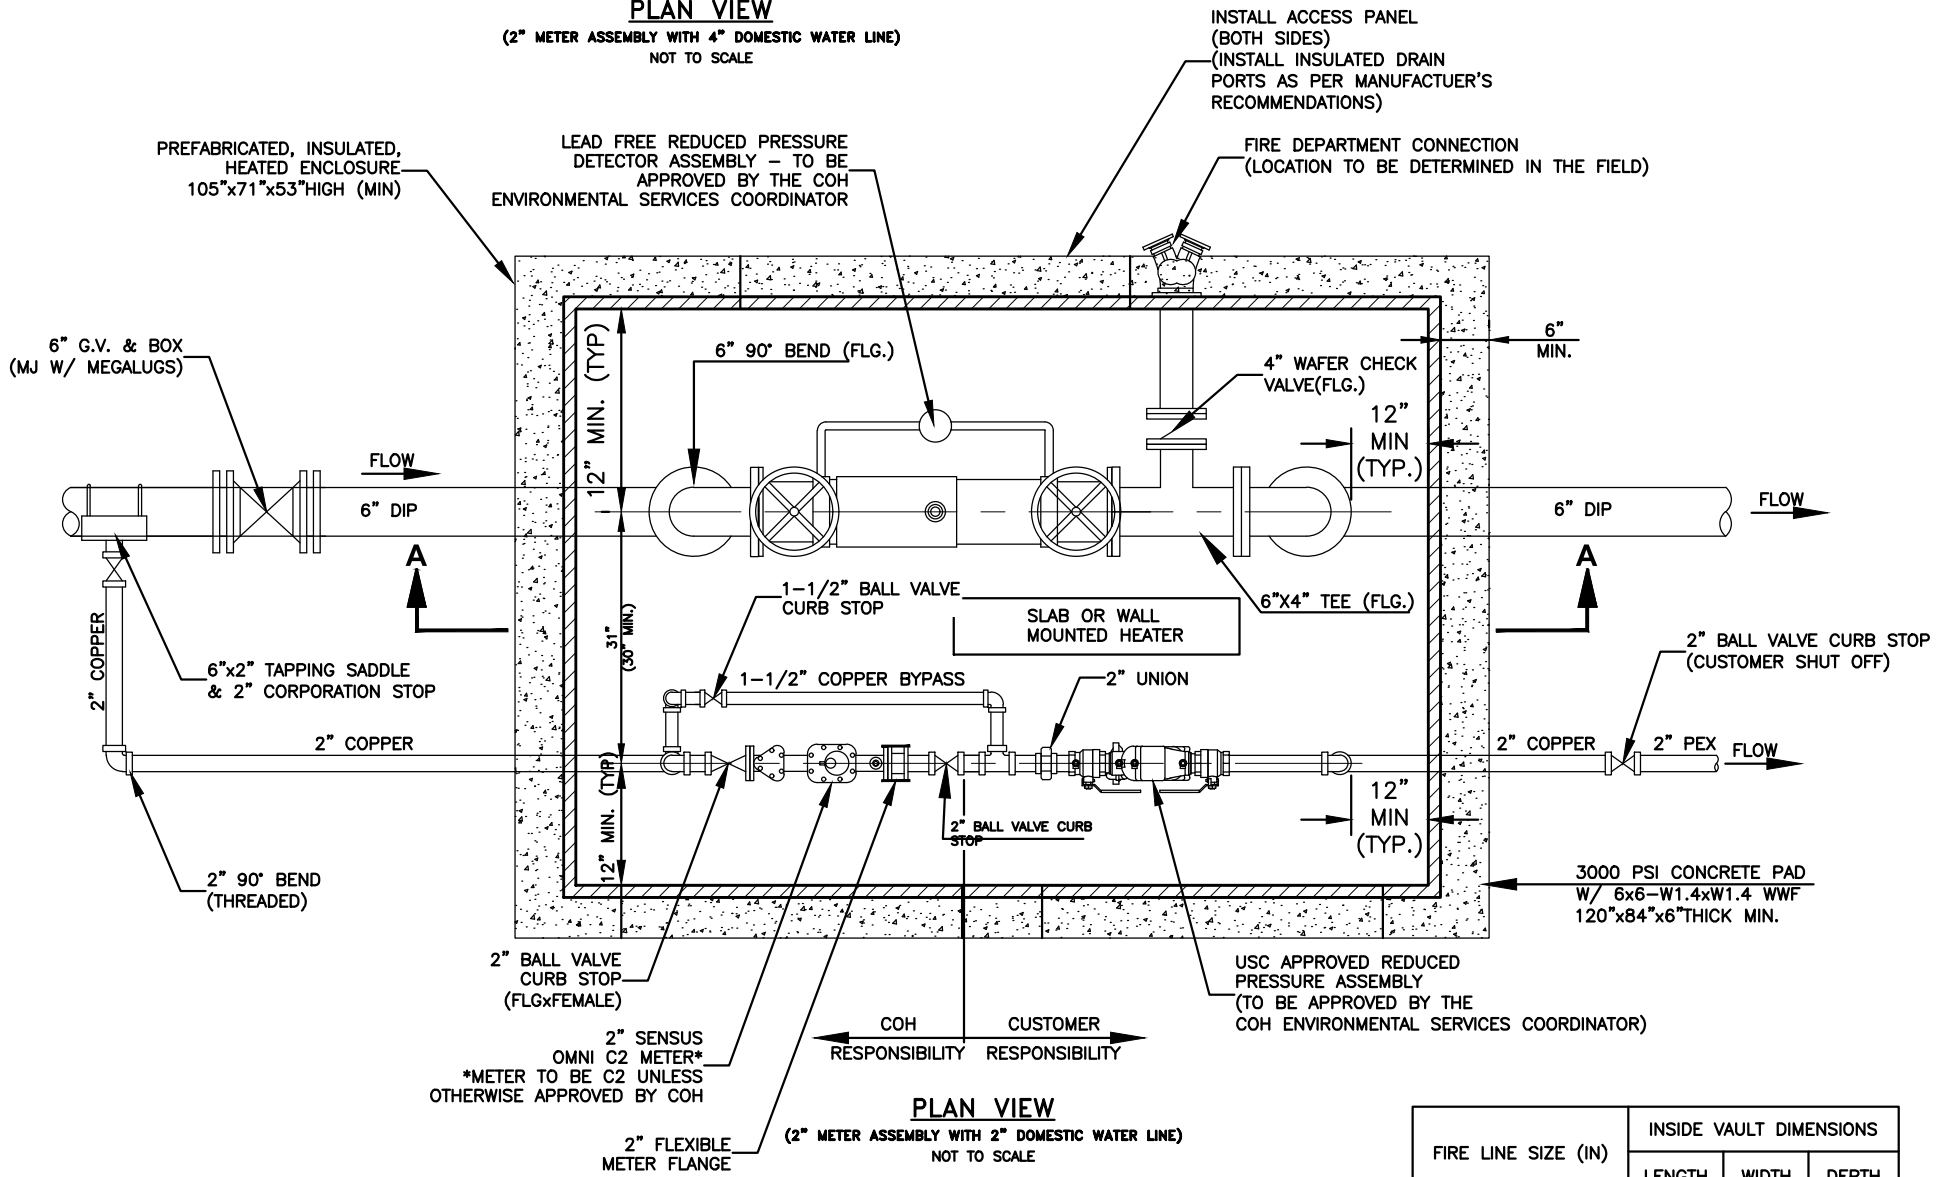


**PLAN VIEW**  
(2" METER ASSEMBLY WITH 2" DOMESTIC WATER LINE)  
NOT TO SCALE

FIRE LINE SIZE (IN)	INSIDE VAULT DIMENSIONS		
	LENGTH	WIDTH	DEPTH
6"	6'-0"	6'-0"	6'-6"
8"	8'-0"	6'-0"	7'-0"
10"	8'-0"	6'-0"	7'-0"

**NOTES:**

1. ALL ABOVE GROUND ENCLOSURES MUST HAVE ADEQUATE DRAINAGE (TWICE THE DIAMETER OF THE SUPPLY PIPE) TO DAYLIGHT ABOVE GRADE.
2. REDUCED PRESSURE BACKFLOW ASSEMBLIES MAY BE LOCATED IN A BUILDING PROVIDED THERE ARE NO OTHER UNPROTECTED TAPS BETWEEN THE MAIN AND THE BUILDING. DRAINAGE OUTLET IN THE BUILDING MUST BE TWICE THE DIAMETER OF THE SUPPLY PIPE.
3. ABOVE GROUND INSULATED VAULTS MUST BE ASSE 1060 APPROVED ABOVE GROUND ENCLOSURES.
4. ALL ASSEMBLIES MUST BE ON THE CURRENT CITY OF HENDERSONVILLE APPROVAL LIST.

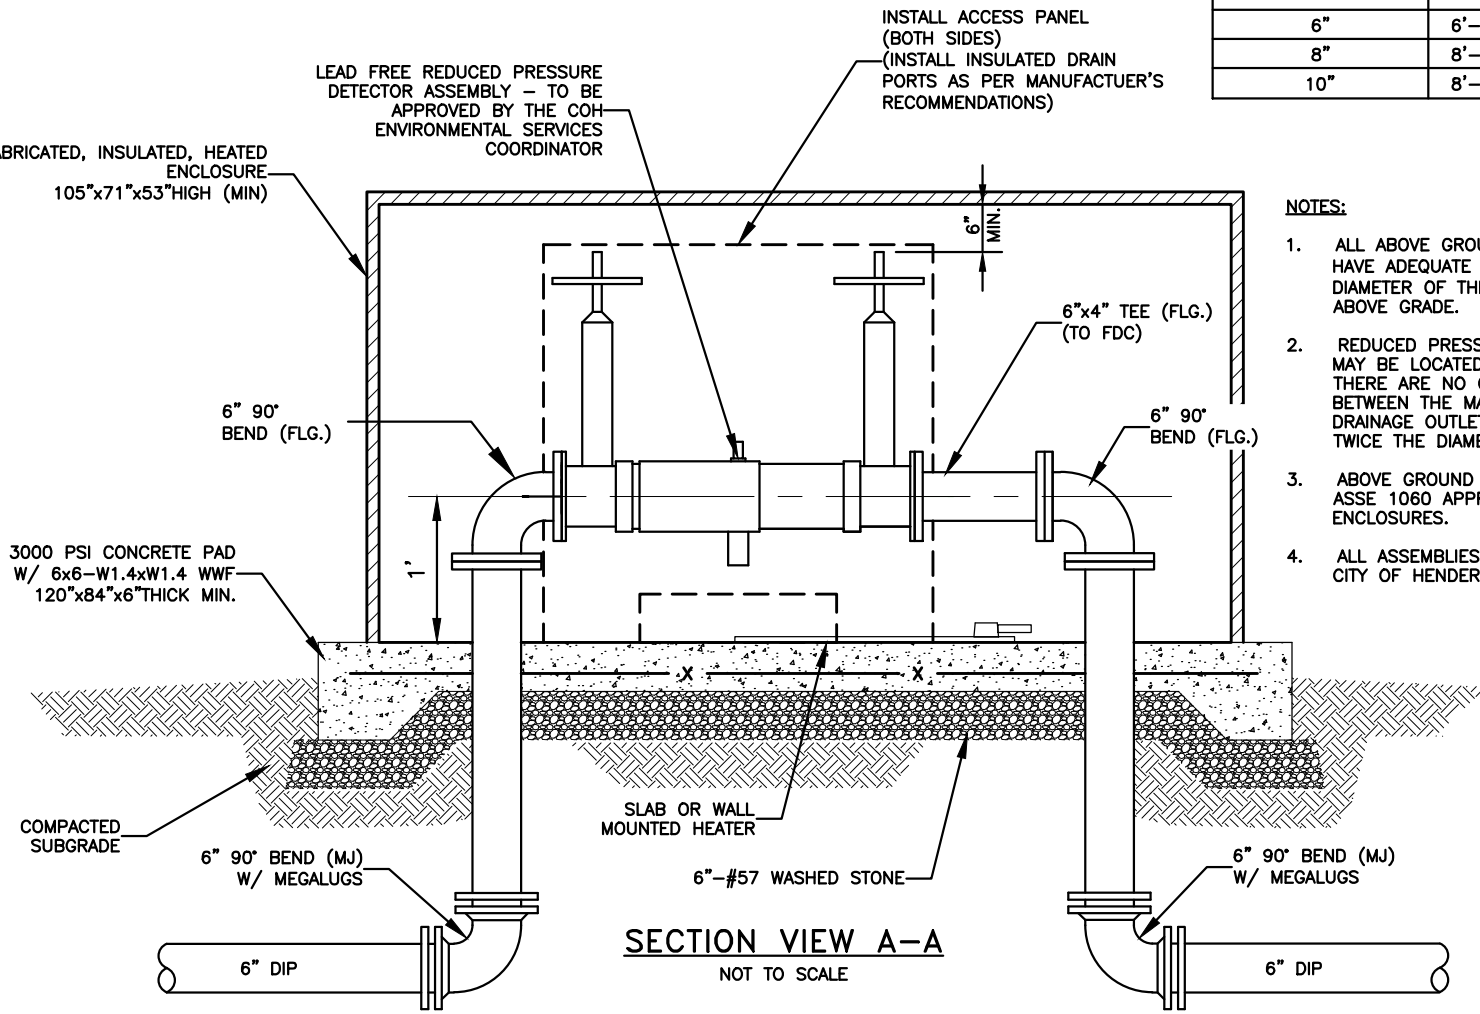

**SECTION VIEW A-A**  
NOT TO SCALE

DATE: 01/12/2019 WD DWG. NO. 15  
SCALE: NOT TO SCALE  
City of Hendersonville Engineering Department  
305 Williams Street  
Hendersonville, NC 28792  
(828) 697-3000 (office)  
[www.cityofhendersonville.org](http://www.cityofhendersonville.org)

# COMMERCIAL WATER SERVICE

## WITH FIRE LINE

