


PLAN VIEW
(2" METER ASSEMBLY WITH 4" DOMESTIC WATER LINE)
NOT TO SCALE

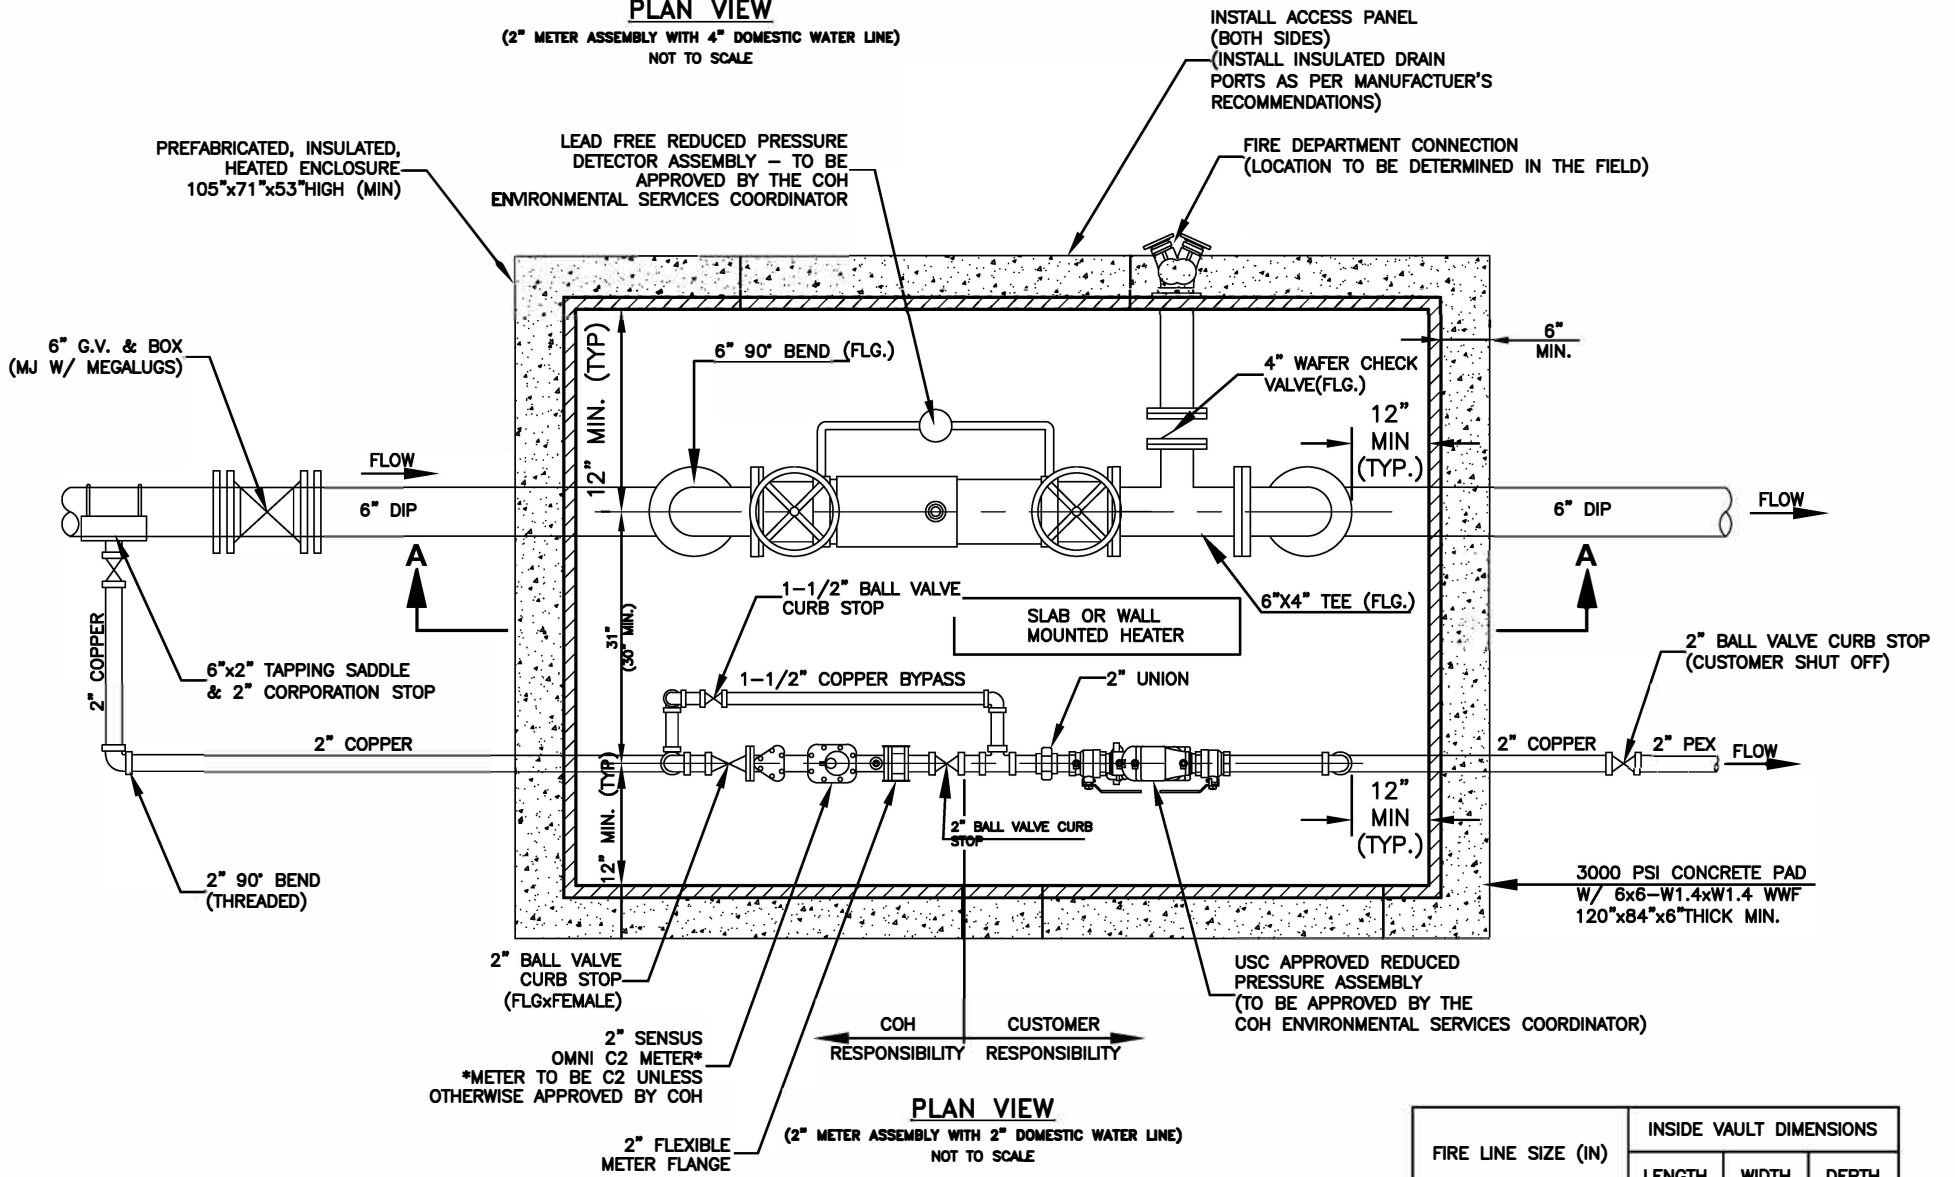


PLAN VIEW
(2" METER ASSEMBLY WITH 2" DOMESTIC WATER LINE)
NOT TO SCALE

FIRE LINE SIZE (IN)	INSIDE VAULT DIMENSIONS		
	LENGTH	WIDTH	DEPTH
6"	6'-0"	6'-0"	6'-6"
8"	8'-0"	6'-0"	7'-0"
10"	8'-0"	6'-0"	7'-0"

NOTES:

1. ALL ABOVE GROUND ENCLOSURES MUST HAVE ADEQUATE DRAINAGE (TWICE THE DIAMETER OF THE SUPPLY PIPE) TO DAYLIGHT ABOVE GRADE.
2. ABOVE GROUND INSULATED VAULTS MUST BE ASSE 1060 APPROVED ABOVE GROUND ENCLOSURES.
3. ALL ASSEMBLIES MUST BE ON THE CURRENT CITY OF HENDERSONVILLE APPROVAL LIST.

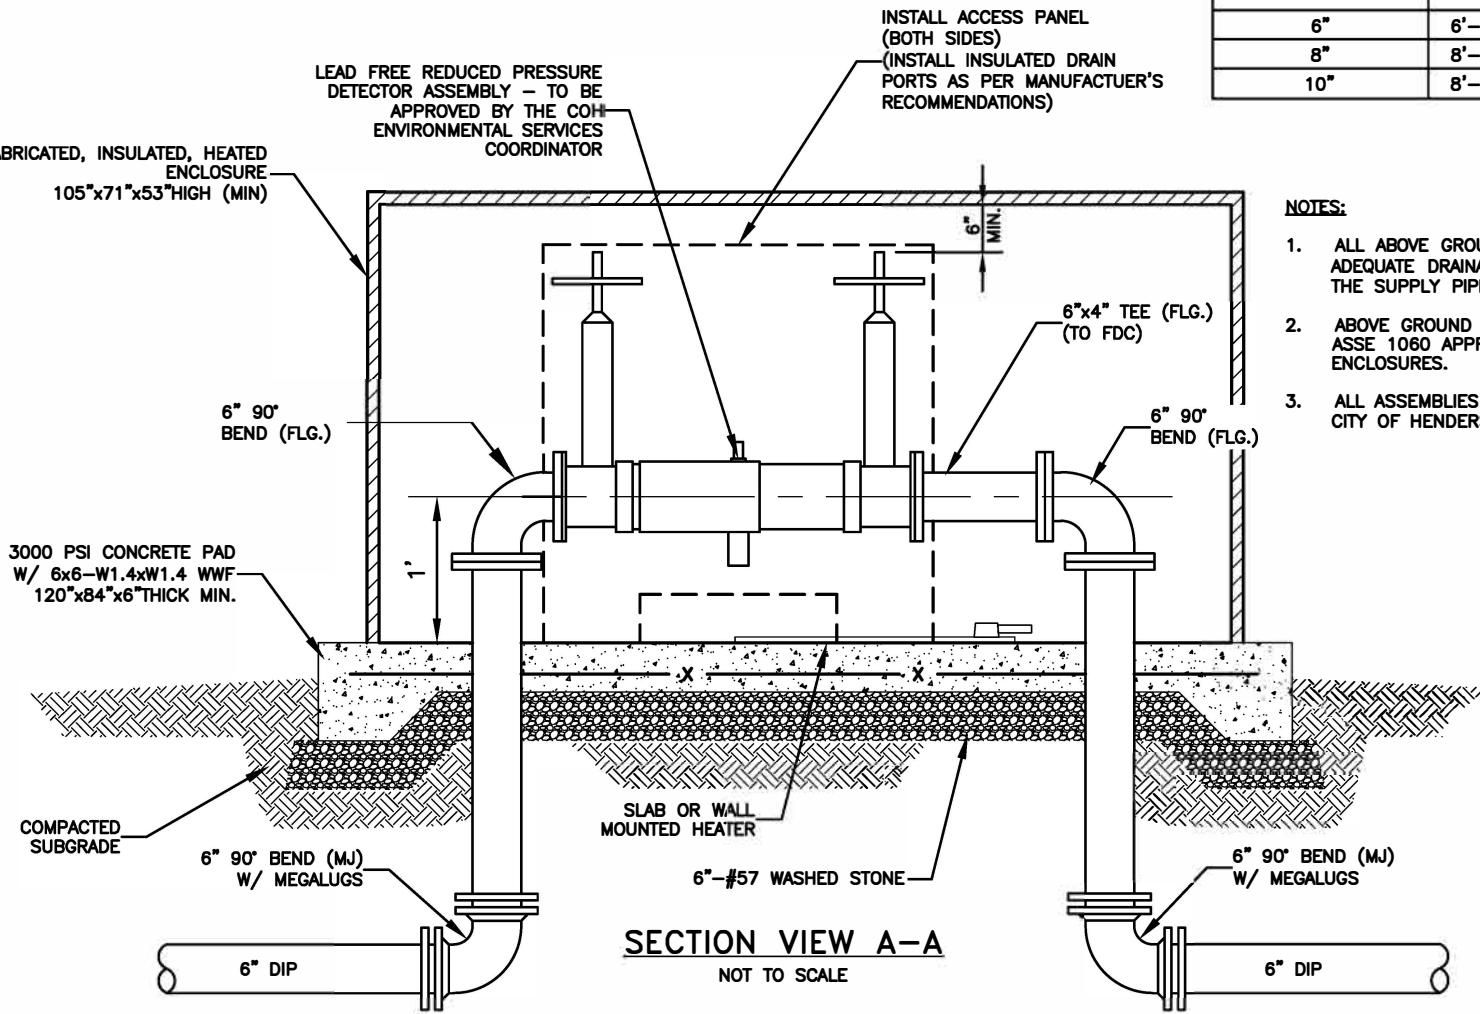

SECTION VIEW A-A
NOT TO SCALE

DATE: 9/20/2021 WD DWG. NO. 15
 SCALE: NOT TO SCALE
 City of Hendersonville Engineering Department
 305 Williams Street
 Hendersonville, NC 28792
 (828) 697-3000 (office)
 www.cityofhendersonville.org

COMMERCIAL WATER SERVICE

WITH FIRE LINE

